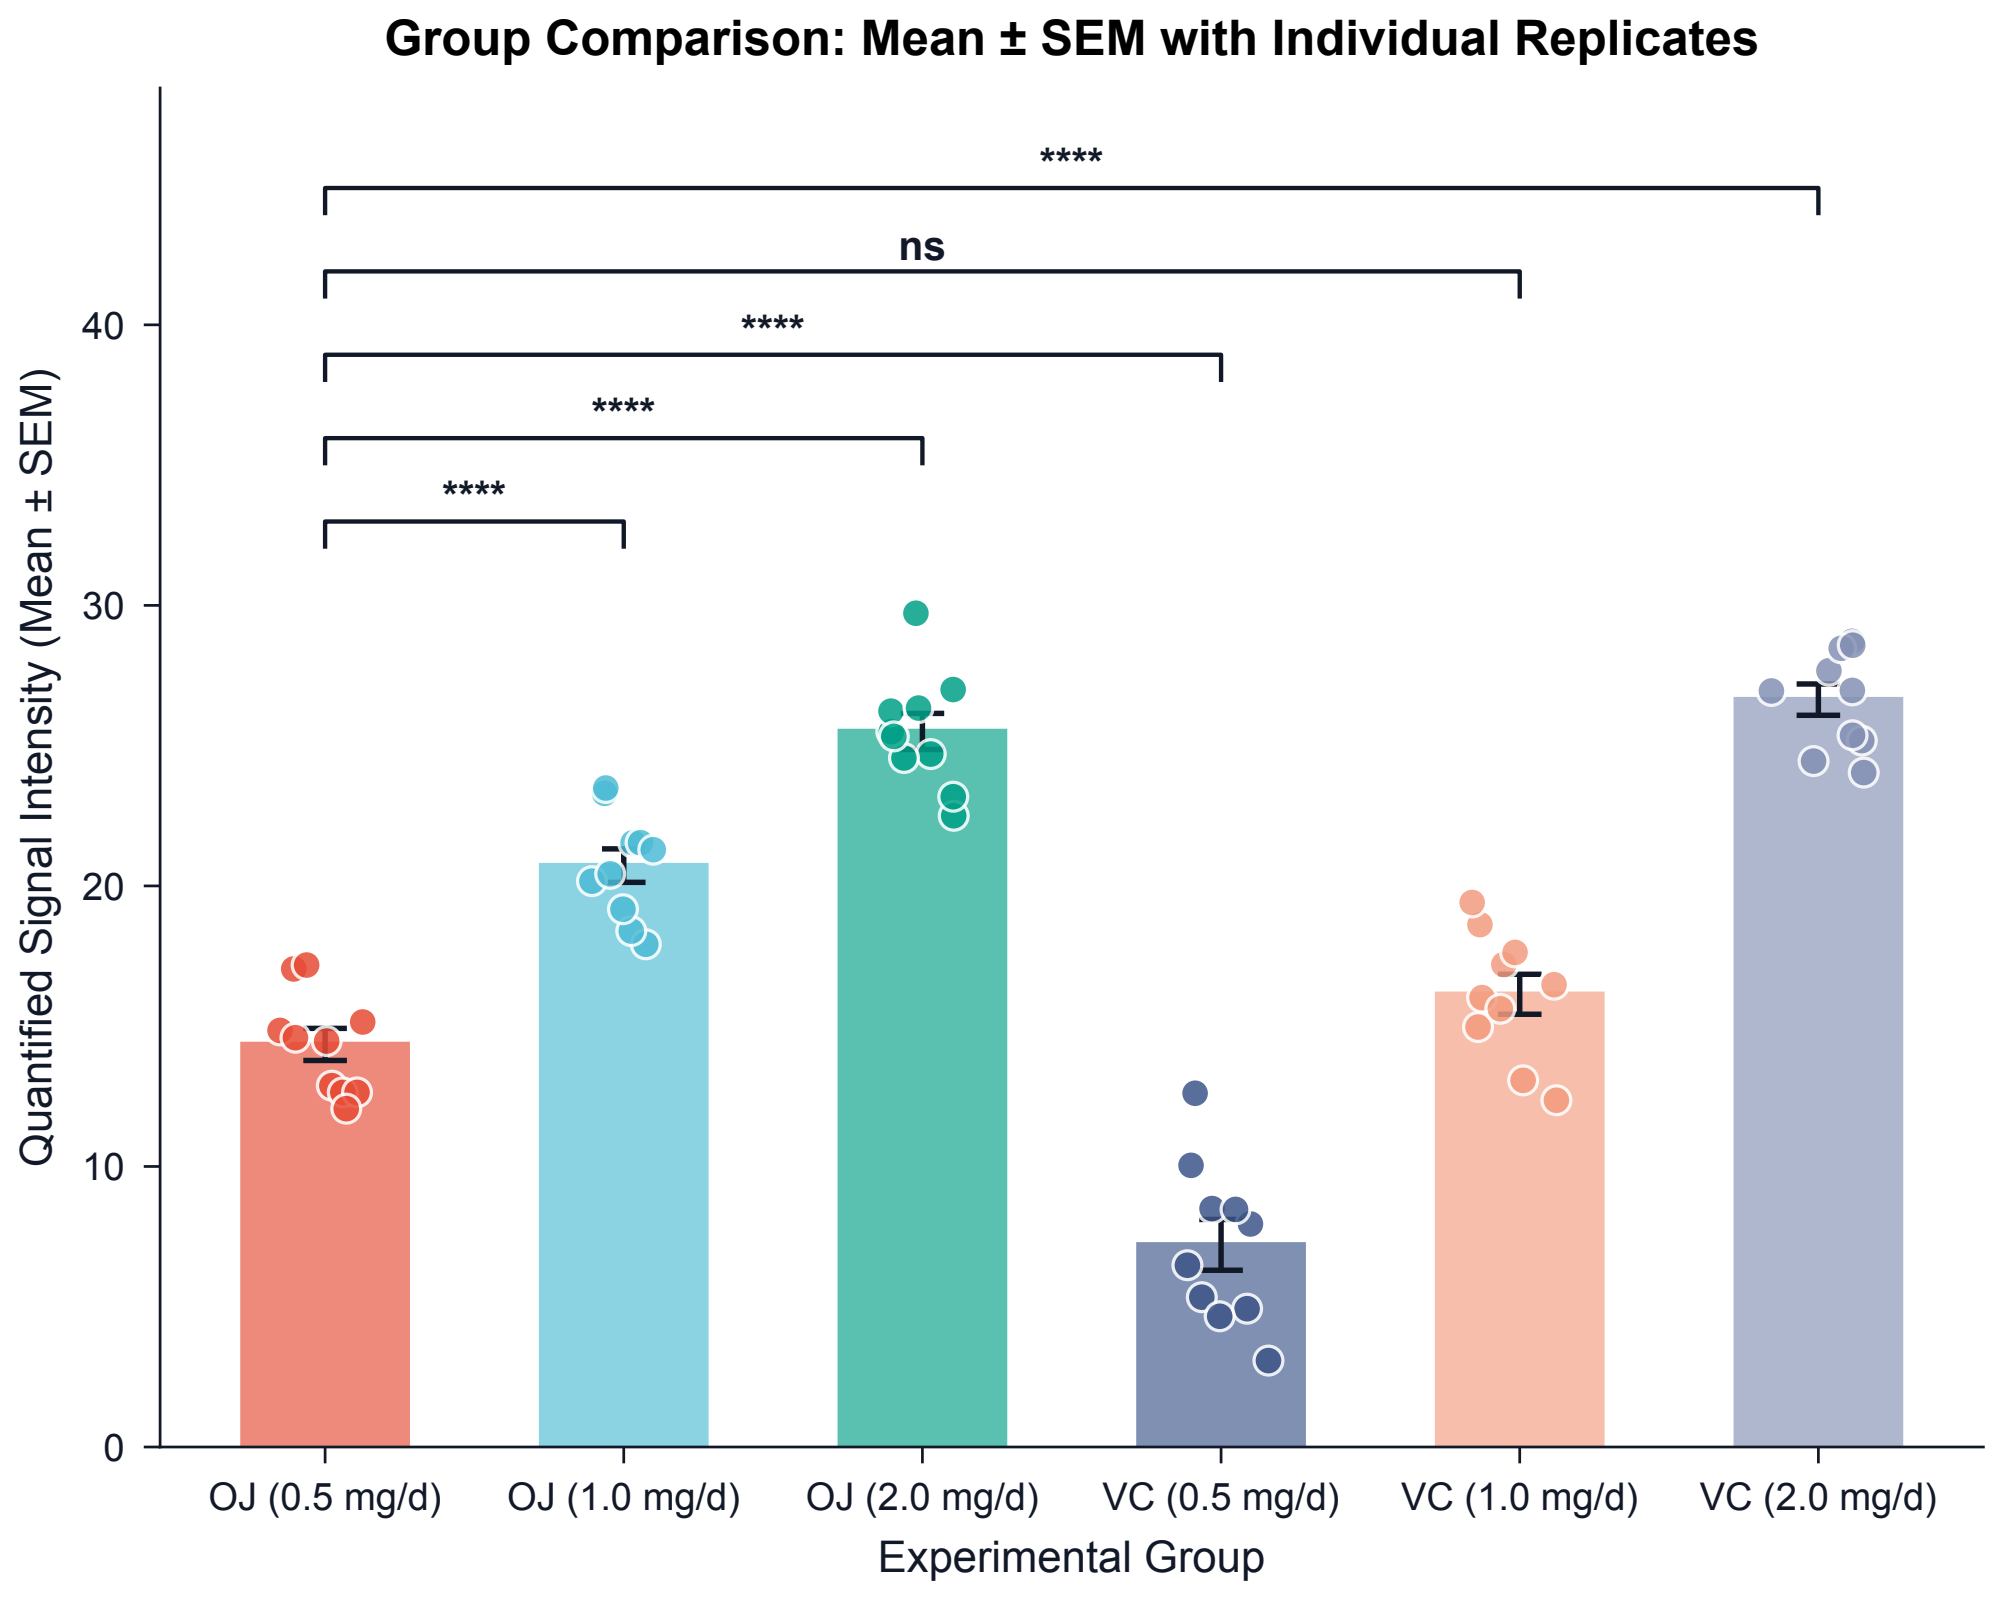
Group Comparison: Mean ± SEM with Individual Replicates
****
ns
****
****
****
Quantified Signal Intensity (Mean ± SEM)
0
10
20
30
40
OJ (0.5 mg/d)
OJ (1.0 mg/d)
OJ (2.0 mg/d)
VC (0.5 mg/d)
VC (1.0 mg/d)
VC (2.0 mg/d)
Experimental Group